


- NOTE 1: DRIVEWAY SHALL BE HANDICAP ACCESSIBLE IF INTERSECTING WITH SIDEWALK.  
 NOTE 2: RADII SHALL NOT EXCEED PROPERTY FRONTAGE BOUNDARY.  
 NOTE 3: REINFORCED CONCRETE FLARED END SECTIONS REQUIRED.  
 NOTE 4: MINIMUM 2 PERCENT SLOPE ON CROSSDRAIN REQUIRED.  
 NOTE 5: PAVE BETWEEN EXISTING STREET AND DRIVEWAY GUTTER WITH 6" OF 3000 POUND PSI CONCRETE OR WITH 8" G.A.B., 3" TYPE "B" AND 2" TYPE "E" ASPHALT.

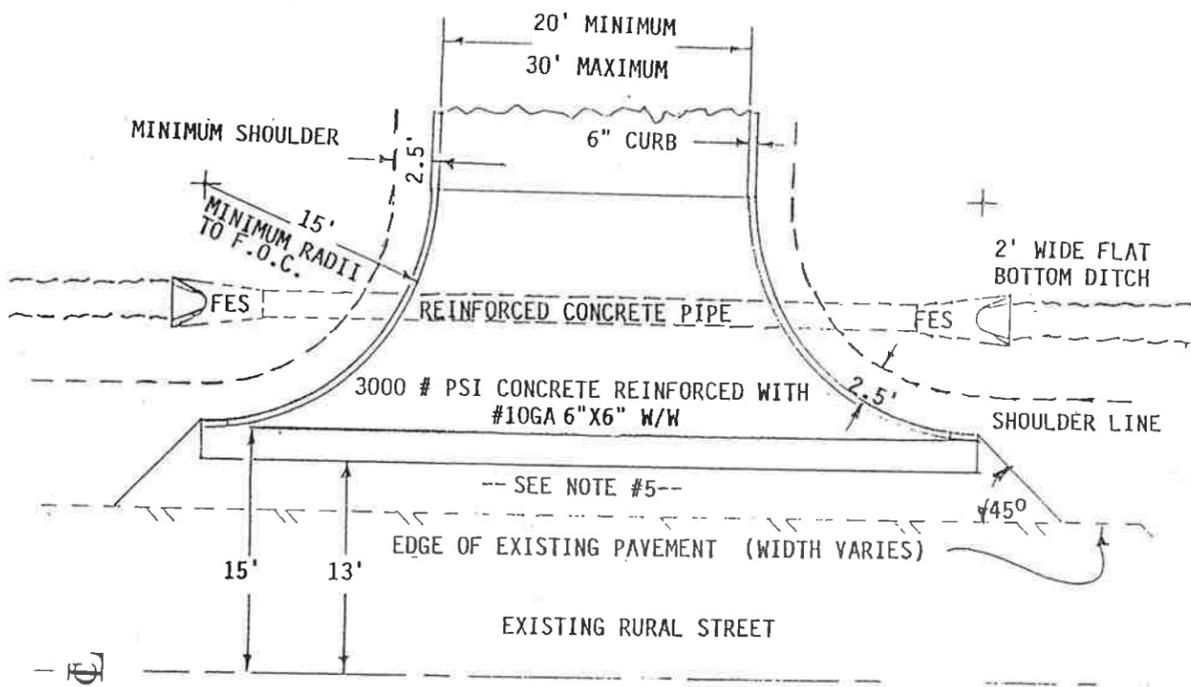



**COMMERCIAL DRIVEWAY**

**RURAL SECTION**

DEPARTMENT OF ENGINEERING  
TRAFFIC ENGINEERING DIVISION

DATE:	DRAWN BY:
-------	-----------

**CL PROFILE SECTION**

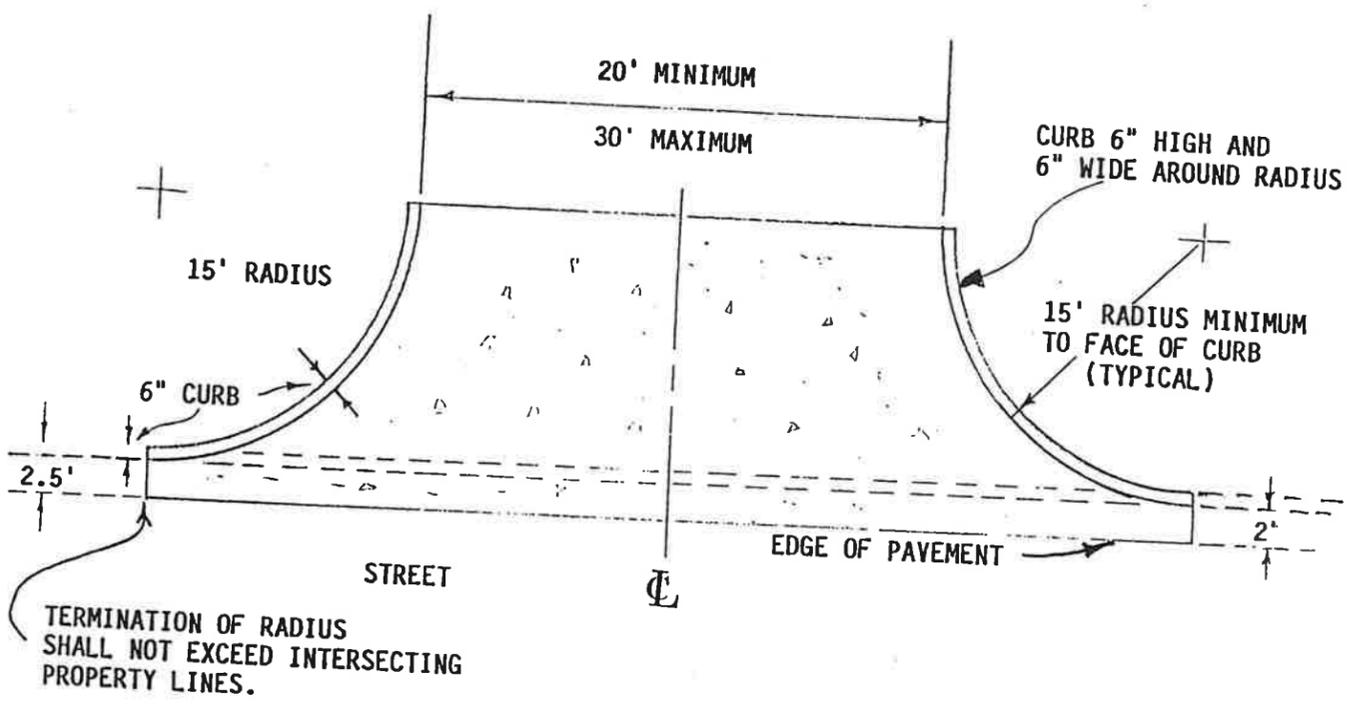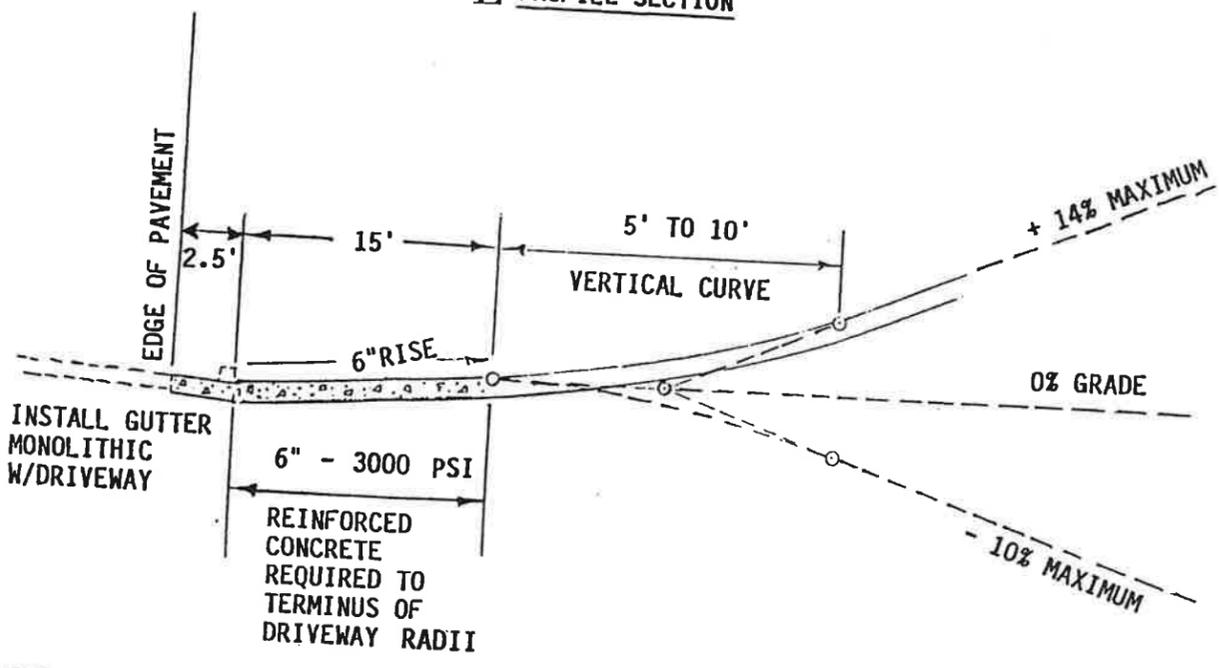

<b>COMMERCIAL DRIVEWAY</b>	
<b>URBAN SECTION</b>	
DEPARTMENT OF ENGINEERING	
TRAFFIC ENGINEERING DIVISION	
DATE:	DRAWN BY: